


**SECTION A-A**

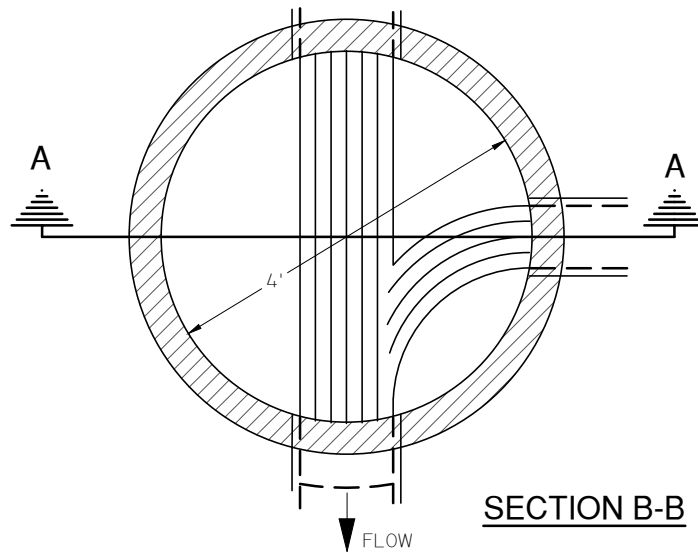

**SECTION B-B**

(IN HIGH WATER TABLE AREAS AN APPROVED WATERPROOFING SHALL BE APPLIED TO THE OUTSIDE OF THE MANHOLE)

NOTE:

- WHERE SEWER PIPE IS JOINED INTO MH, USE FLEXIBLE WATER TIGHT CONNECTION SUCH AS A-LOK, KORNSEAL OR APPROVED EQUAL
- BELOW 15' DEPTH MEASURED FROM PRESENT GROUND SURFACE, MANHOLE WALLS SHALL BE 12" THICK AND DIAMETER OF BASE 7'4"

**CITY OF WYOMING**  
ENGINEERING DEPARTMENT

**PRE-CAST SANITARY  
SEWER MANHOLE**

DRAWN BY - KJM

CHECKED BY - JJO

DATE DRAWN - 3-2021

DATE REVISED - 3-2021

**S-7**

**PRECAST SANITARY SEWER MANHOLE**